



AUGUST METRO LIMITS

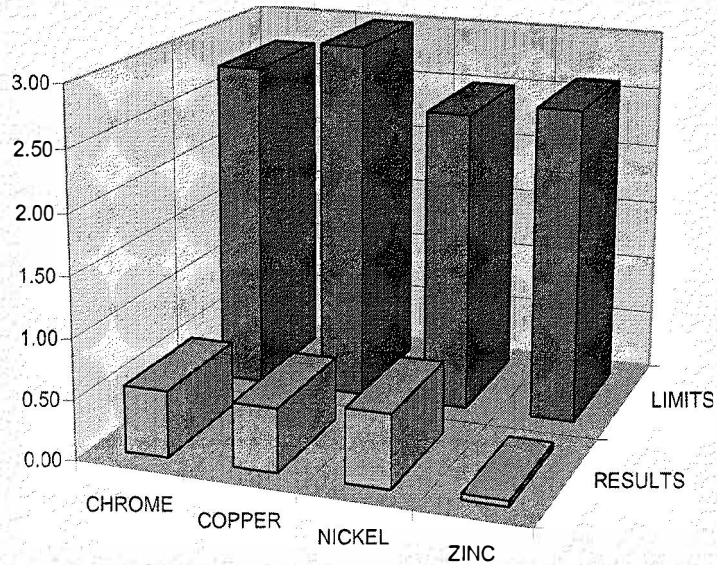

ALASKAN COPPER WORKS

3200 FACILITY
AUGUST 6, 2009
COMPOSITE M04455

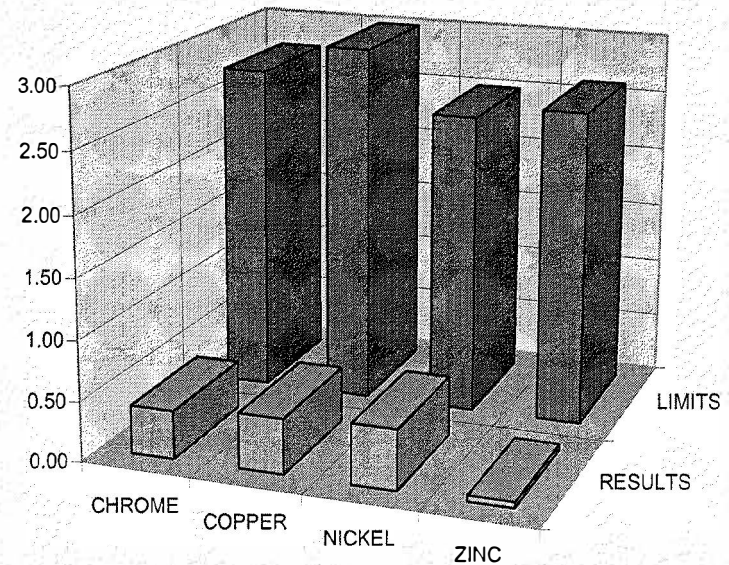

ALASKAN COPPER WORKS

3200 FACILITY
AUGUST 13, 2009
COMPOSITE M04488


VISUAL REPRESENTATION OF THE LAB RESULTS

NOTE: ALL LABORATORY RESULTS HAVE BEEN CHANGED FROM ppb TO ppm FOR REPORTING PURPOSES

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.55	0.53	0.61	0.05
LIMITS	2.75	3.00	2.50	2.61


	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.40	0.46	0.50	0.05
LIMITS	2.75	3.00	2.50	2.61

AUGUST METRO LIMITS

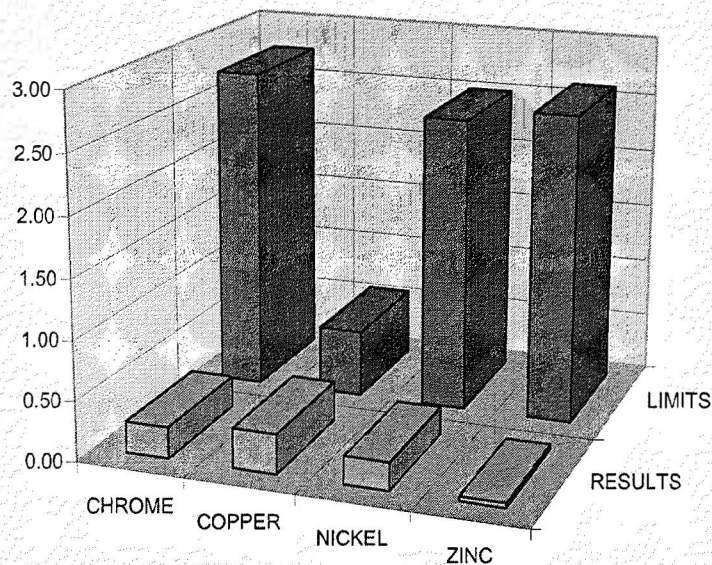

ALASKAN COPPER WORKS

3200 FACILITY
AUGUST 20, 2009
COMPOSITE M04514

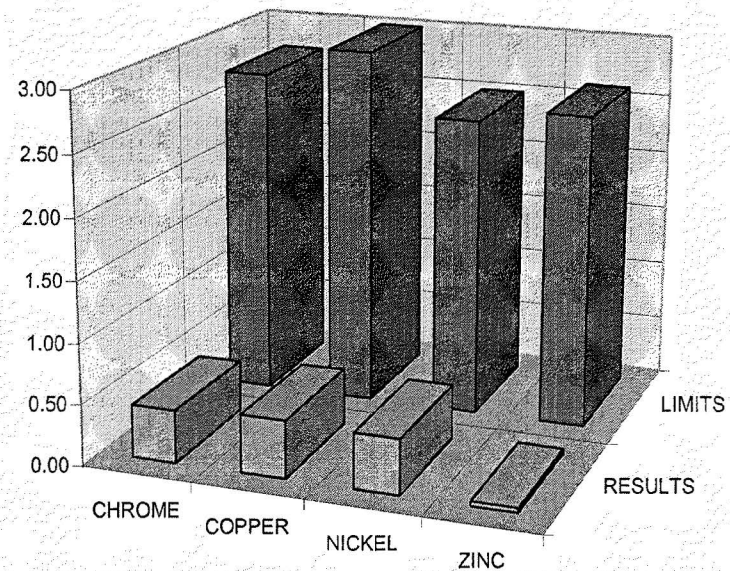

ALASKAN COPPER WORKS

3200 FACILITY
AUGUST 27, 2009
COMPOSITE M04537

VISUAL REPRESENTATION OF THE LAB RESULTS

NOTE: ALL LABORATORY RESULTS HAVE BEEN CHANGED FROM **ppb** TO **ppm** FOR REPORTING PURPOSES

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.26	0.33	0.23	0.04
LIMITS	2.75	0.57	2.50	2.61

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.43	0.47	0.45	0.04
LIMITS	2.75	3.00	2.50	2.61

FRIEDMAN & BRUYA, INC.

ENVIRONMENTAL CHEMISTS

James E. Bruya, Ph.D.
Charlene Morrow, M.S.
Yelena Aravkina, M.S.
Bradley T. Benson, B.S.
Kurt Johnson, B.S.

3012 16th Avenue West
Seattle, WA 98119-2029
TEL: (206) 285-8282
FAX: (206) 283-5044
e-mail: fbi@isomedia.com

August 31, 2009

Gerry Thompson, Project Manager
Alaskan Copper Works
628 South Hanford
Seattle, WA 98134


Dear Mr. Thompson:

Included are the invoices from the testing of material submitted on August 11, 2009 from the Alaskan Copper Works, F&BI 908066, 908067 and 908065 projects. The invoices were originally sent to Landau Associates and they have requested that we redirect them to your firm.

We appreciate this opportunity to be of service to you and hope you will call if you should have any questions.

Sincerely,

FRIEDMAN & BRUYA, INC.



Sula A. Olson
Office Manager

Enclosures
NAA0812R.DOC